

FEATURES


- Brass construction
- Bath-mount or deck-mount installation options
- Available with lever or round handle

CODES/STANDARDS APPLICABLE

Specified model meets or exceeds the following:

- ASME/ANSI A112.18.1M

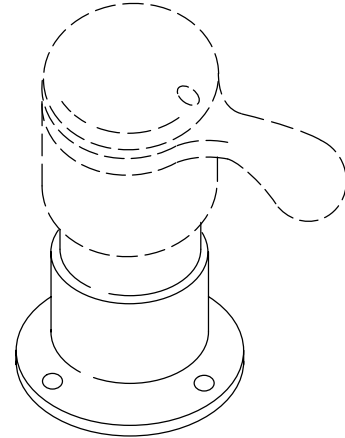



TRANSFER VALVE TRIM
K-T9540
ALSO K-408-K, K-409-K



COLORS/FINISHES

- CP Polished Chrome
- PB Polished Brass
- Other Refer to Faucets Price Book for additional finishes

SPECIFIED MODEL: For complete faucet, both faucet trim and transfer valve must be specified.

Model	Description	 <input type="checkbox"/> ADA	
K-T9540-4	With Lever Handle	<input type="checkbox"/> CP <input type="checkbox"/> PB <input type="checkbox"/> Other_____	
K-T9540-7	With Round Handle		<input type="checkbox"/> CP <input type="checkbox"/> PB <input type="checkbox"/> Other_____
Required Accessory			 
K-408-K	Transfer Valve For Bath-Mount Installations	<input type="checkbox"/> NA	
K-409-K	Transfer Valve For Deck-Mount Installations		<input type="checkbox"/> NA

PRODUCT SPECIFICATION:

Two- or three-way transfer valve trim shall be of brass construction. Optional feature shall be bath-mount or deck-mount installation. Transfer valve trim shall be Kohler Model K-T9540-_____-_____- and transfer valve shall be K-_____-K-NA.


INSTALLATION NOTES

Bath and handshower outlets required for two-way transfer valve.

Bath, handshower, and auxiliary outlets required for three-way transfer valve.

When used as a two-way transfer valve (bath and handshower), the installer must cap the auxiliary outlet. Do not install spouts with flow restrictors or shower units on the bath outlet.

* For installation on cast iron baths, collar should be installed with flange facing downward. Opening in cast iron must be 1-7/8" D. minimum.

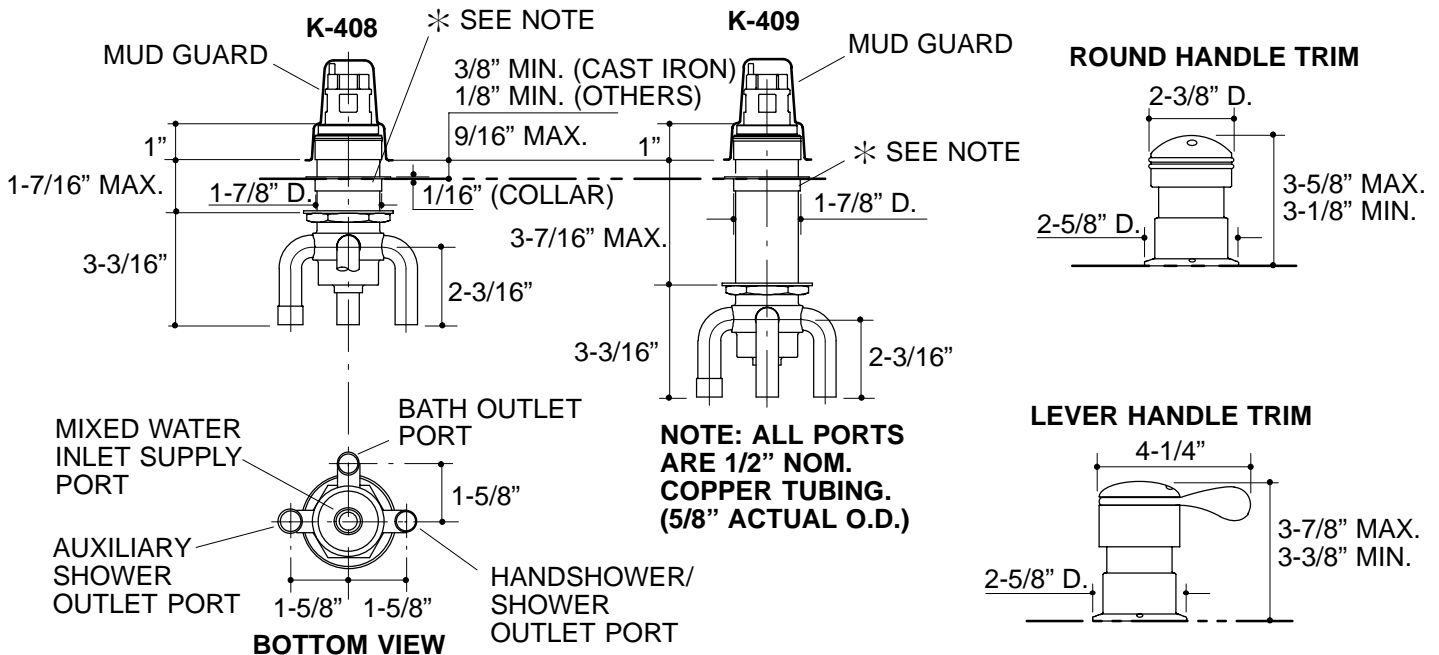

316

PRODUCT DIAGRAM

K-T9540, K-408-K, K-409-K Transfer Valve Trim

Page 2 of 2
 86840-4-AB

THE BOLD LOOK
KOHLER