T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690

Model No.

EC-3100-HG

Item No.

ANSI A117.1 (ADA)

1:8


Sheet: 1 of 2

Scale:

UL 1951

09/10/18

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

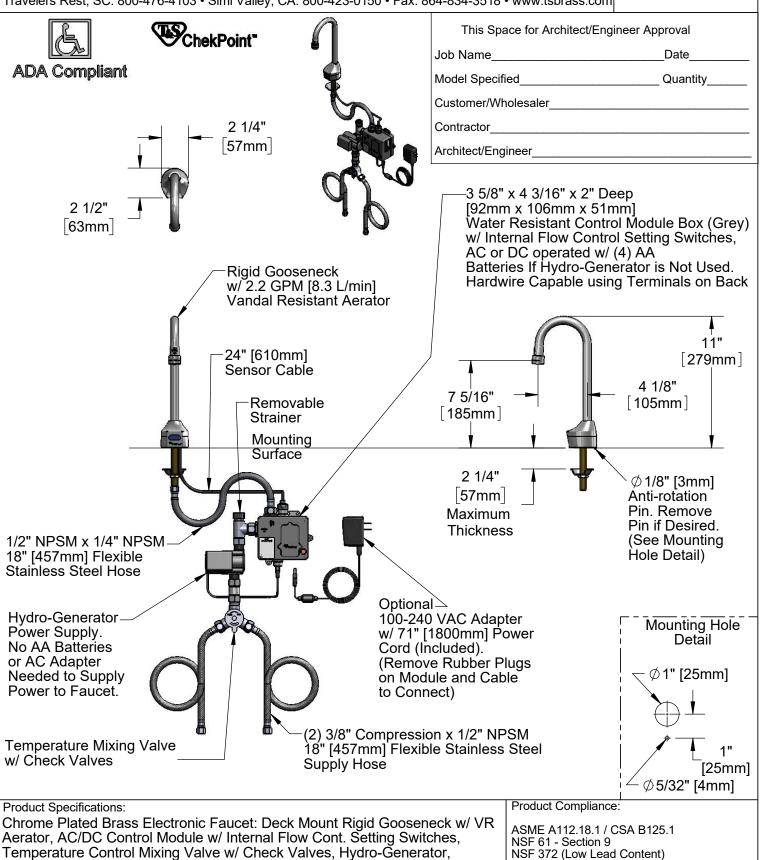

Temperature Control Mixing Valve w/ Check Valves, Hydro-Generator,

JRM

Approved:

JHB

Date:

18" Hot & Cold Supply Stop Flexible Connector Hoses

Checked:

Drawn:

AMG



T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690

Model No.


EC-3100-HG

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

ITEM NO.	SALES NO.	DESCRIPTION
1	B-0199-06	VR 2.2 GPM Aerator, 55/64-27 Female
2	044A	3/8" to Aerator Adapter
3	006575-45	O-Ring
4	017195-45	Angled Sensor w/ Cable
5	016297-45	Inlet Hose, Faucet, 1/2" NPSM-F x 1/4" NPSM-F
6	016647-45	ChekPoint Module (Grey)
7	5EF-0002	Plug-in AC Transformer
8	5EF-0006	Mechanical Mixing Valve
9	5EF-0005	Supply Hose, 9/16-24 Female x 1/2" NPSM
10	015425-45	Vandal Resistant Key
11	EC-HYDROGEN	Hydro-Generator and Swivel Coupling
12	017506-45	1/2 NPSM Swivel Coupling
13	FC-FILTER	Replacement Filter



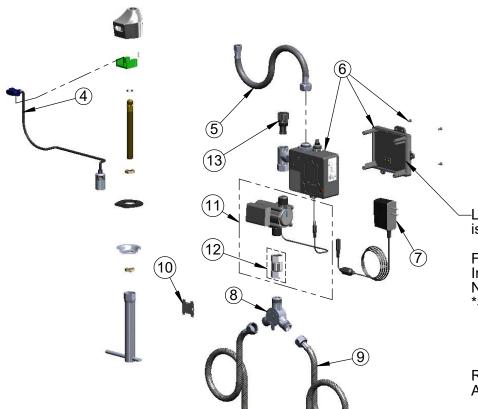

Label for Flow Control Switch Settings is Located on Inside of Back Cover.

Flow Control Switches are Located Inside Module Housing in Black Box Next to Battery Compartment.
*Switches are Set to DEFAULT Position:

- - Auto Time Out = 15 Seconds
 - Shut Off Delay = 1 Second
 - Auto Flush = ÓFF

Remove (4) Screws and Back Cover to Access Switches.

*Available Water Flow Control Selections:

- Auto Time Out: 15 sec, 30 sec, 45 sec, 60 sec, 3 min, 20 min
 Shut Off Delay: 1 sec, 10 sec, 15 sec, 30 sec
 Auto Flush (30 Seconds After Every 12 Inactive Hours): ON or OFF

Product Specifications:

Chrome Plated Brass Electronic Faucet: Deck Mount Rigid Gooseneck w/ VR Aerator, AC/DC Control Module w/ Internal Flow Cont. Setting Switches, Temperature Control Mixing Valve w/ Check Valves, Hydro-Generator, 18" Hot & Cold Supply Stop Flexible Connector Hoses

Product Compliance:

ASME A112.18.1 / CSA B125.1 NSF 61 - Section 9 NSF 372 (Low Lead Content) ANSI A117.1 (ADA) UL 1951

Drawn: AMG Checked: JRM Approved: JHB Date: 09/10/18 Scale: NTS Sheet: 2 of 2